



- NOTES:
- DO NOT USE CONDULET FITTING IN CONDUITS FOR FIBER CABLE. USE MINIMUM 12" RADIUS BENDS.

1 FLOOR PLAN-64C-1  
1/8" = 1'-0"

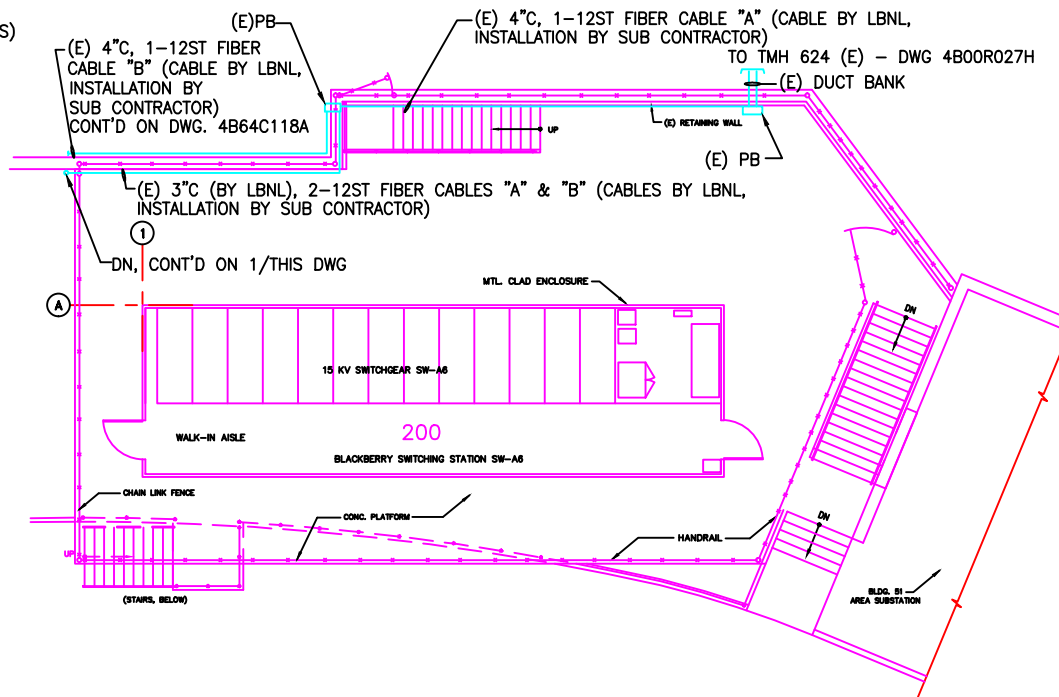


- NOTES:
- 'NTD' GROUP TO GET 4PR CABLES FROM ELECTRIC SHOP AND INSTALL IT FROM 'MXL' TO 'TELCO' BACKBOARD. LEAVE 15 FEET OF COILED CABLES AT 'FACP' END. TERMINATE AND IDENTIFY ONE PAIR FOR CONNECTION TO BLDG 48. REFER TO WORK ORDER TO 'TSC' FOR SUCH CONNECTIONS.

2 FLOOR PLAN-64C-2  
1/8" = 1'-0"

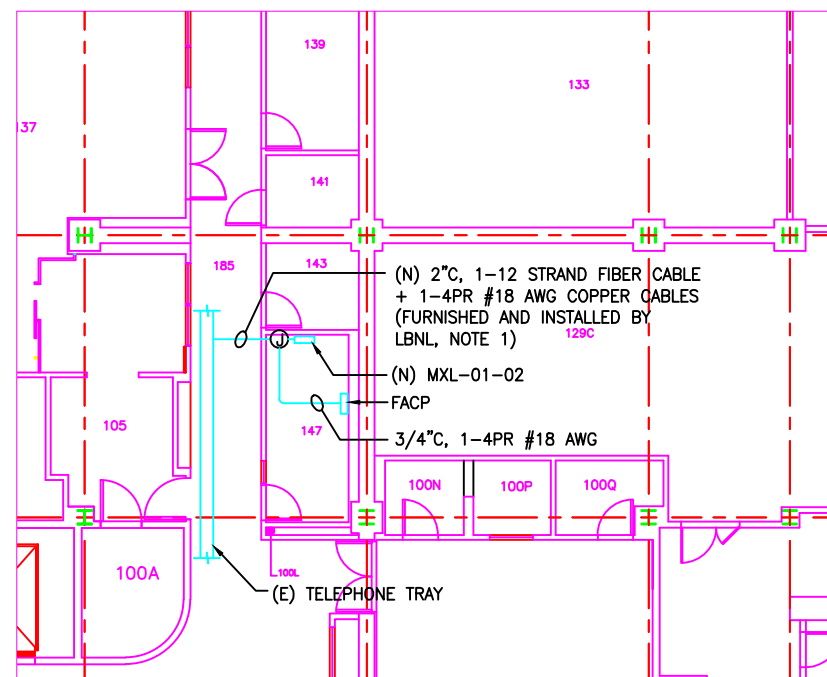

- NOTES:
- CONTACT M. GUPTA FOR DETAILED MOUNTING OF MEDIA CONVERTER BOX.

3 FLOOR PLAN-2-1  
1/8" = 1'-0"

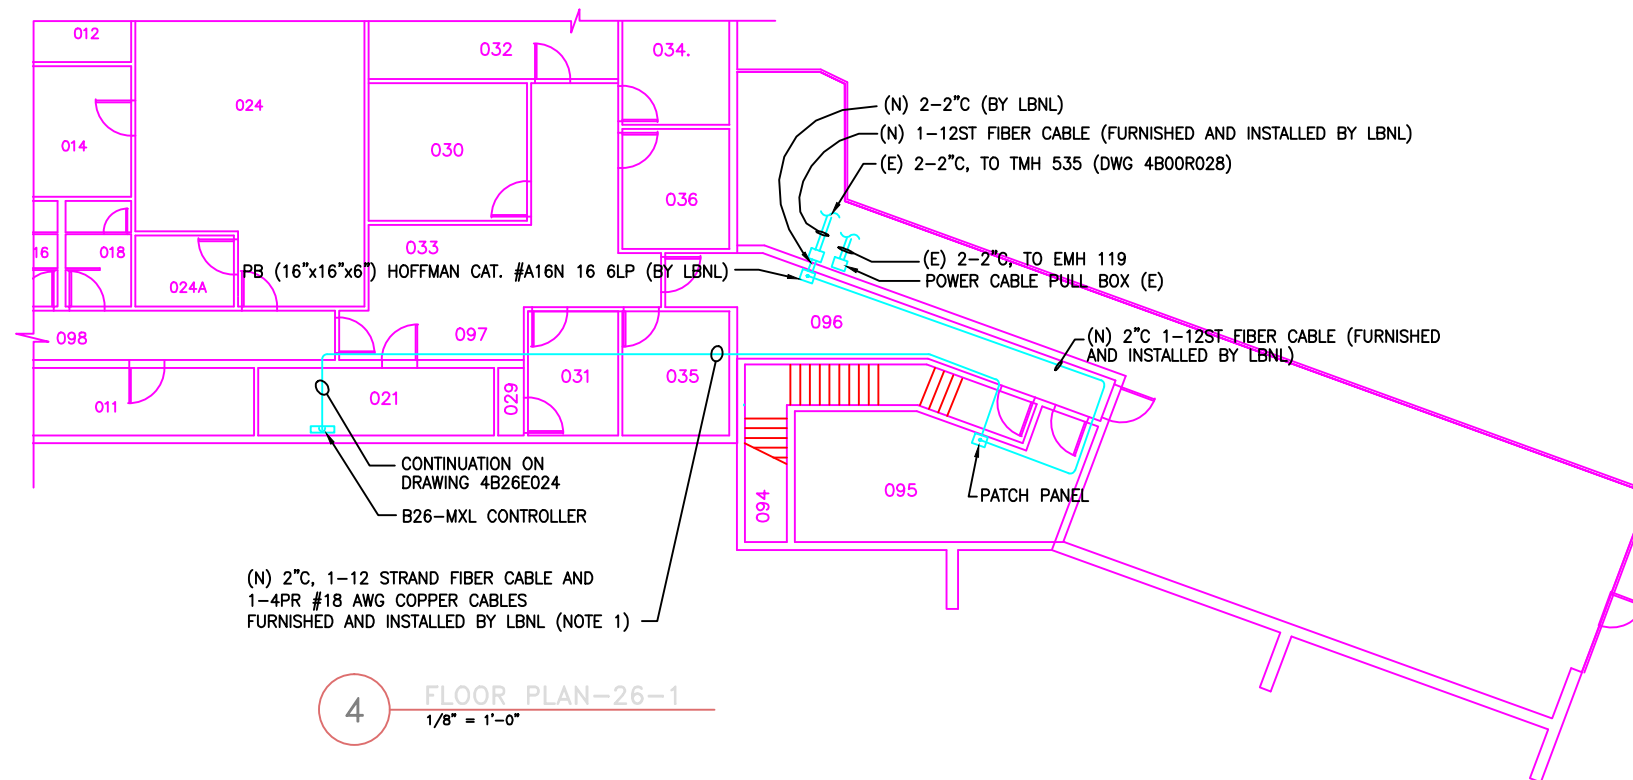

4 FLOOR PLAN-26-1  
1/8" = 1'-0"

PROFESSIONAL SEAL (IF REVISION, APPLIES ONLY TO REVISED WORK)	TITLE 2 CONSTRUCTION  2/15/2005							48 SCADA FIBER NETWORK PARTIAL FLOOR PLANS	DRAWN BY	IPM	DATE	2/17/2005	
									CHECKED BY				
									APPROVED BY				
									CAD FILE PATH 00018980				
									SCALE As Noted				
									DRAWING NO. 4B48E033_				
								UNIVERSITY OF CALIFORNIA LAWRENCE BERKELEY NATIONAL LABORATORY FACILITIES DIVISION				SHEET E-3	
								PROJECT NO. FF5012				3 OF 5	